



NOTES:


1. WORK THIS DRAWING WITH STANDARD DRAWING DR-4 FOR CONCRETE AND HDPE FLARED END SECTIONS. REFER TO TABLES ON STANDARD DRAWING DR-4 FOR DIMENSIONS.
2. CLASS B CONCRETE CAST-IN-PLACE REINFORCED SLABS ARE REQUIRED FOR ALL PIPE DIAMETERS.
3. STONE RIPRAP APRONS ARE REQUIRED WITH FLARED END SECTIONS FOR ALL PIPE DIAMETERS.
4. SLOPE TO CENTERLINE OF PIPE LESS THAN OR EQUAL TO 18" DIAMETER. SLOPE 1:1 FOR PIPES LARGER THAN 18" DIAMETER.
5. FOR INSTALLATION OF CONCRETE COLLARS AT EXISTING FLARED END SECTIONS TO REMAIN, THE 6"X6" CONCRETE SUPPORT SHALL BE ELIMINATED WITHIN THE LIMITS OF THE EXISTING END SECTION.
6. CONCRETE COLLAR TO BE PAID FOR AS INCIDENTAL CONCRETE.

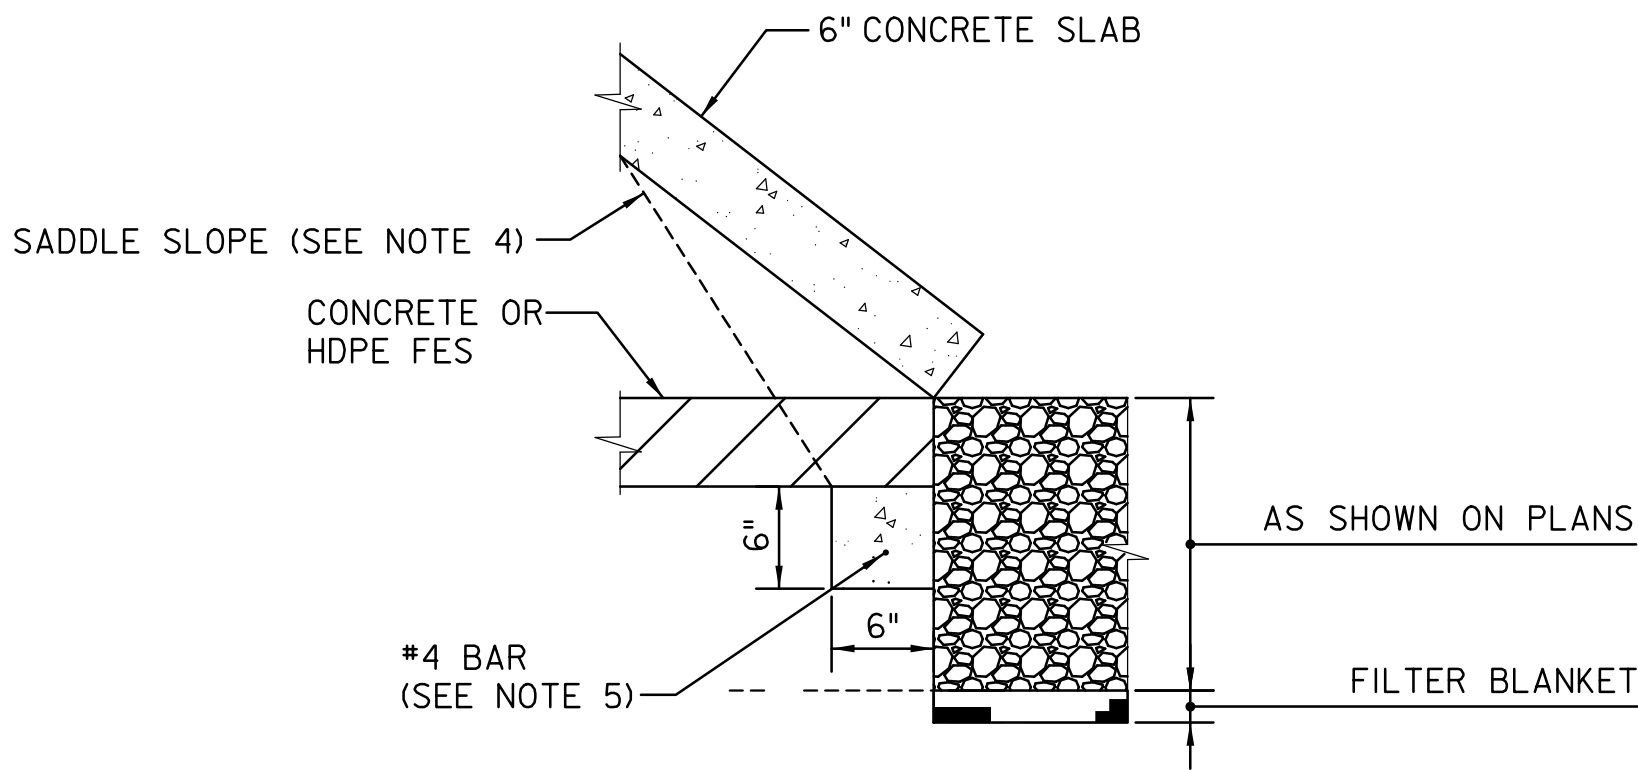


INSET "A"

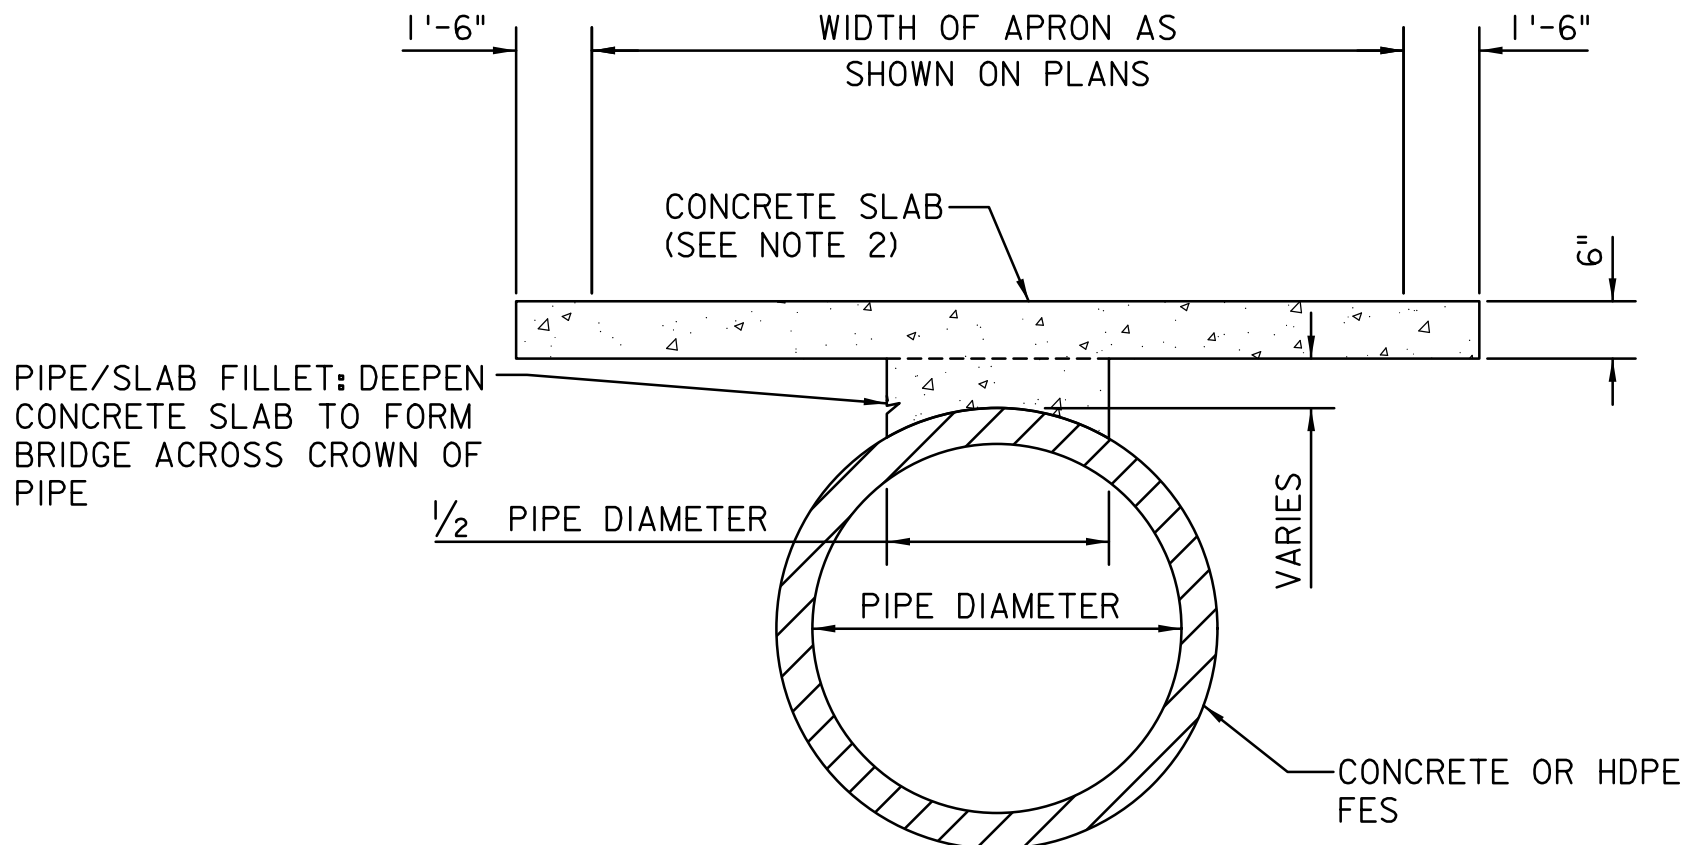


SECTION A-A

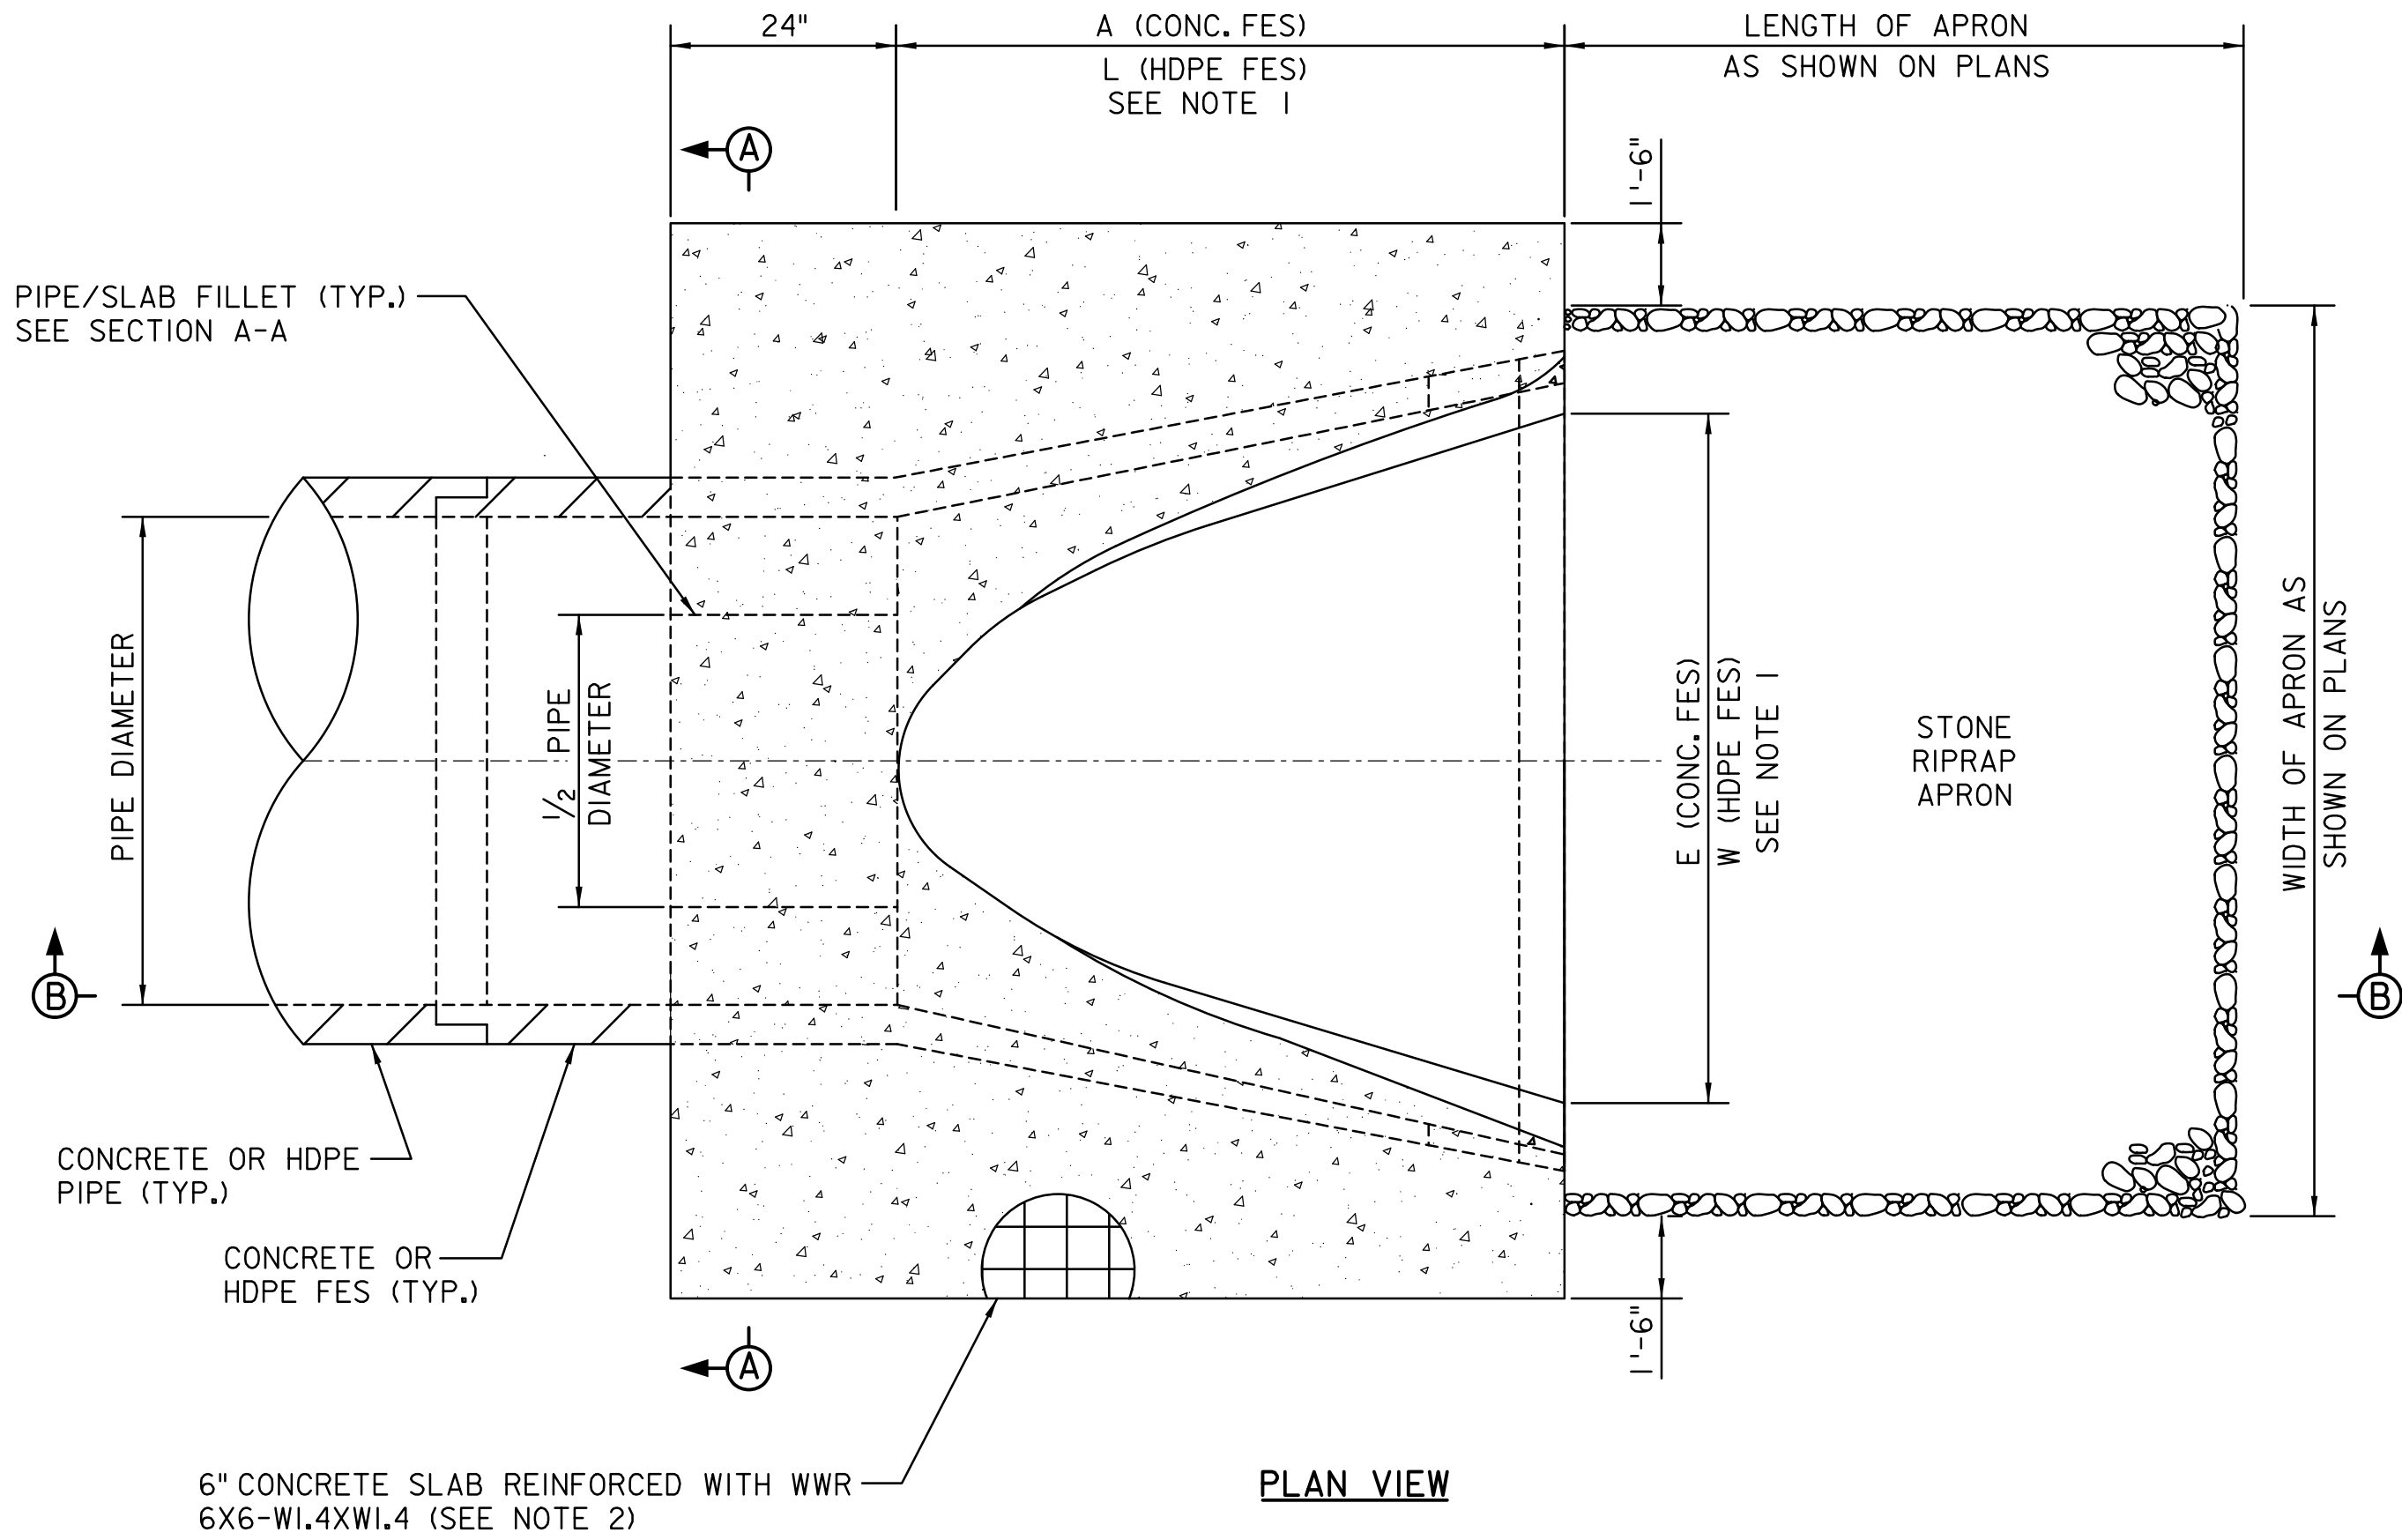

PLAN VIEW

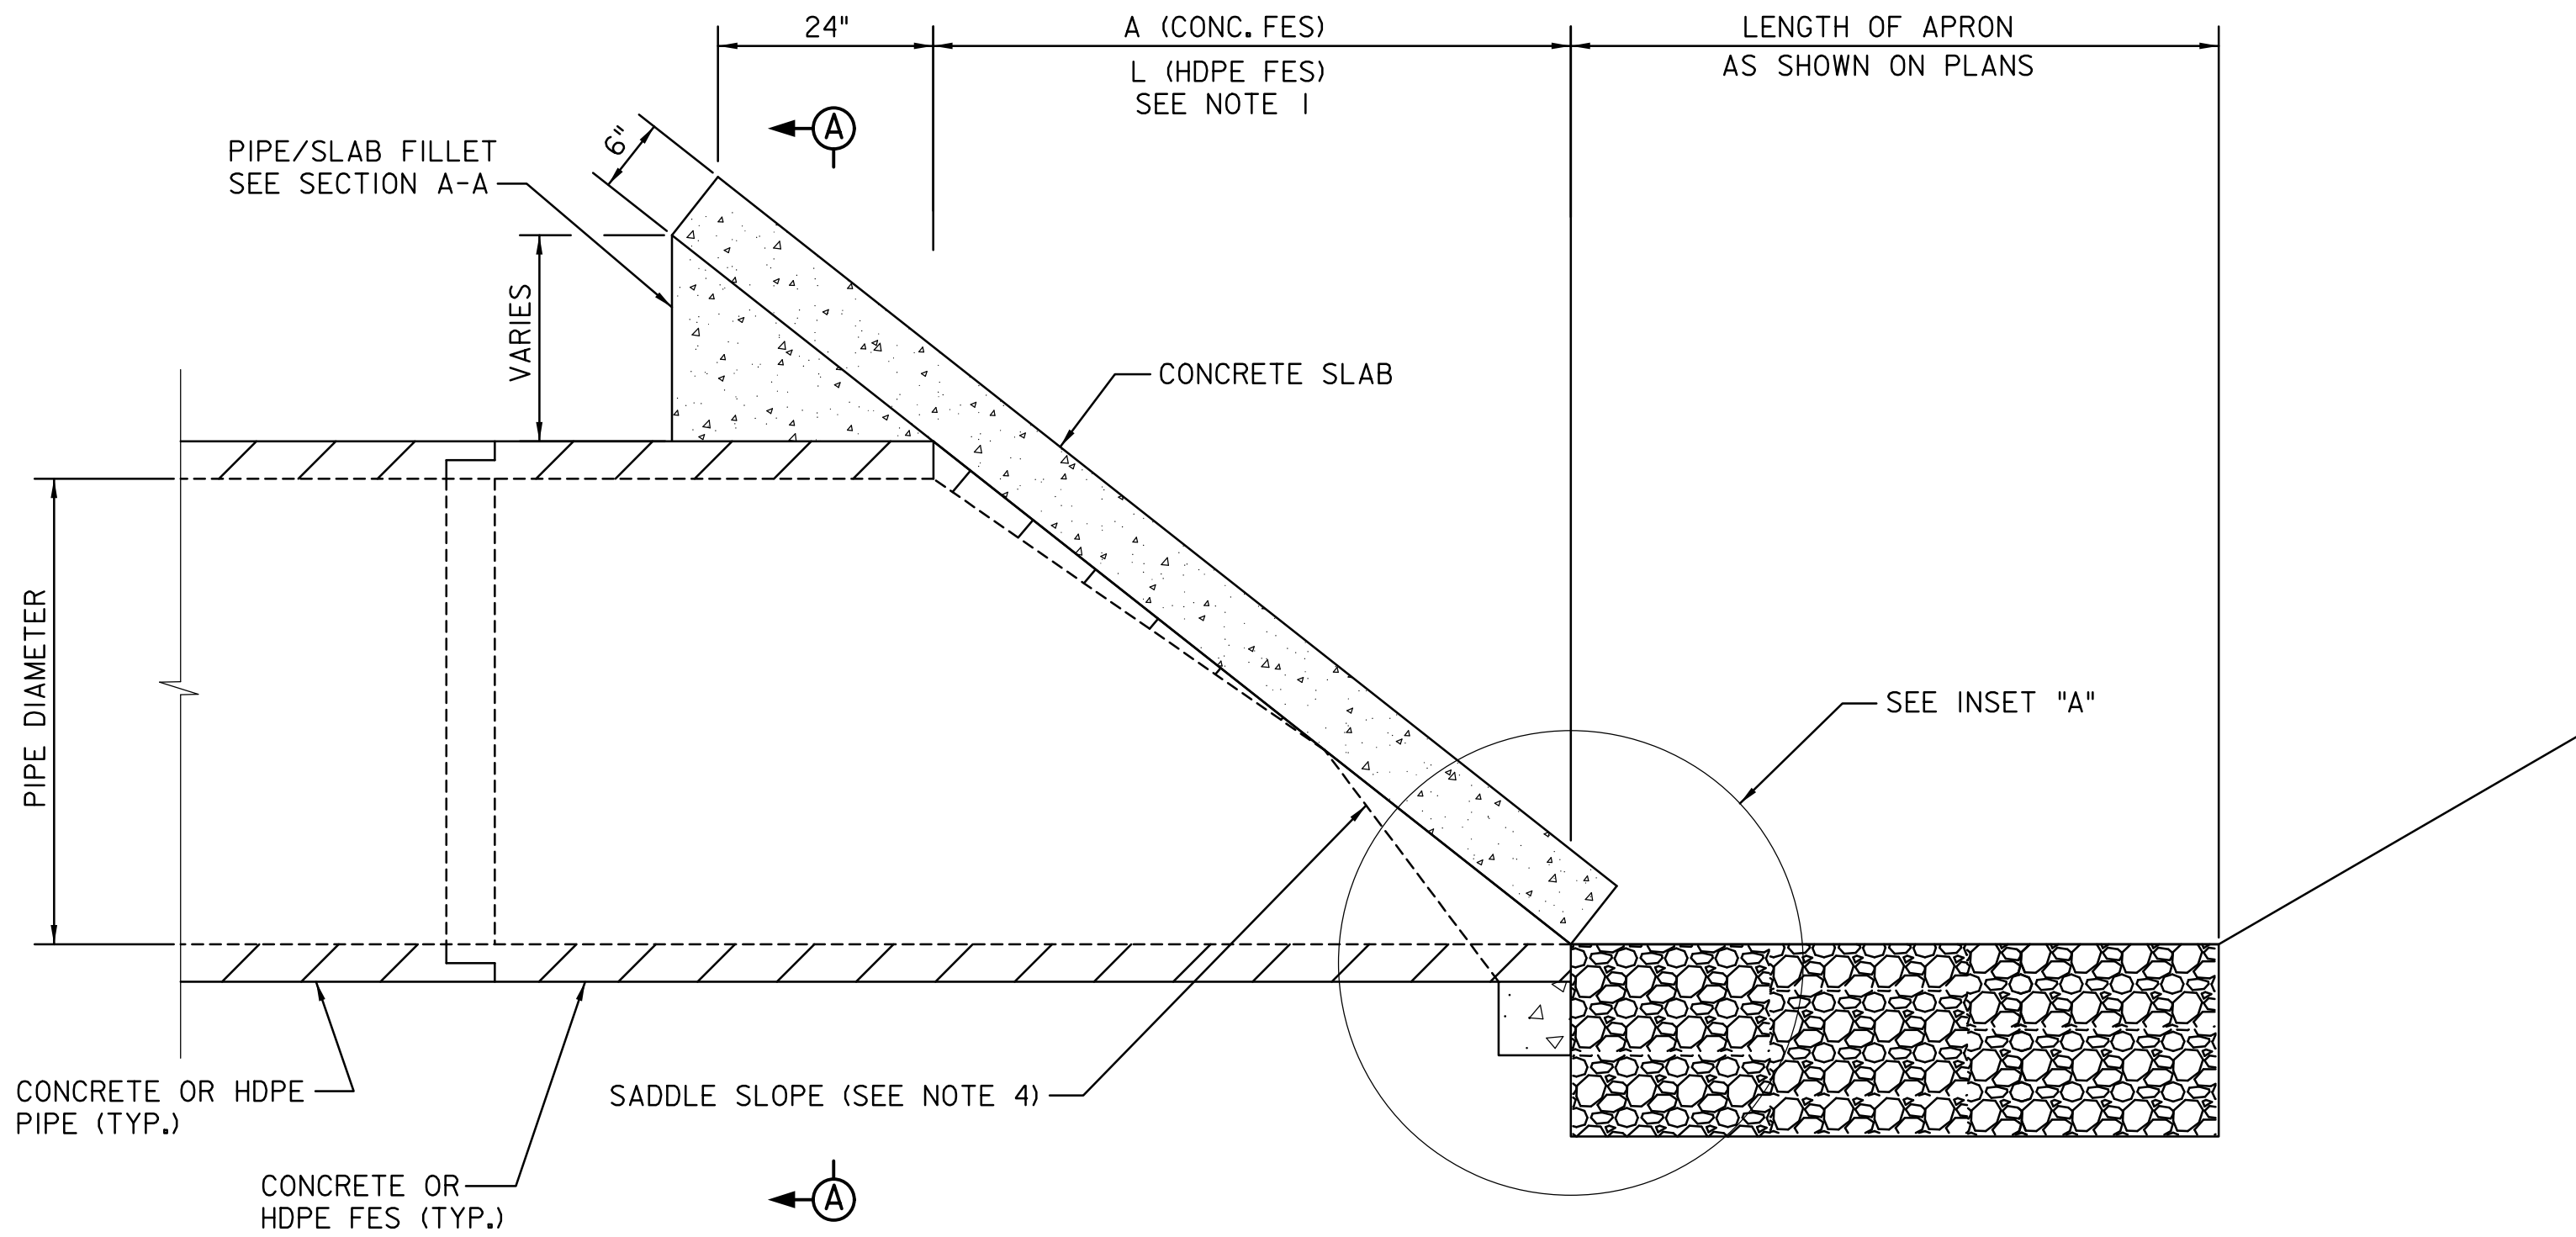

SECTION B-B

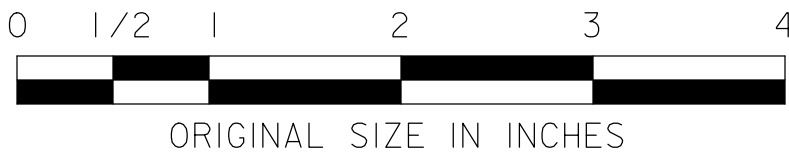

CONCRETE COLLAR FOR FLARED END SECTIONS
(NOT TO SCALE)

0	ORIGINAL DRAWING	03/26
REV.	DESCRIPTION	DATE

NEW JERSEY TURNPIKE AUTHORITY
**NEW JERSEY TURNPIKE
GARDEN STATE PARKWAY**
STANDARD DRAWINGS

FLARED END SECTION
CONCRETE COLLAR

OFFICE OF THE CHIEF ENGINEER
NEW JERSEY TURNPIKE AUTHORITY
WOODBIDGE, NEW JERSEY

STANDARD DRAWING

DR-4A