




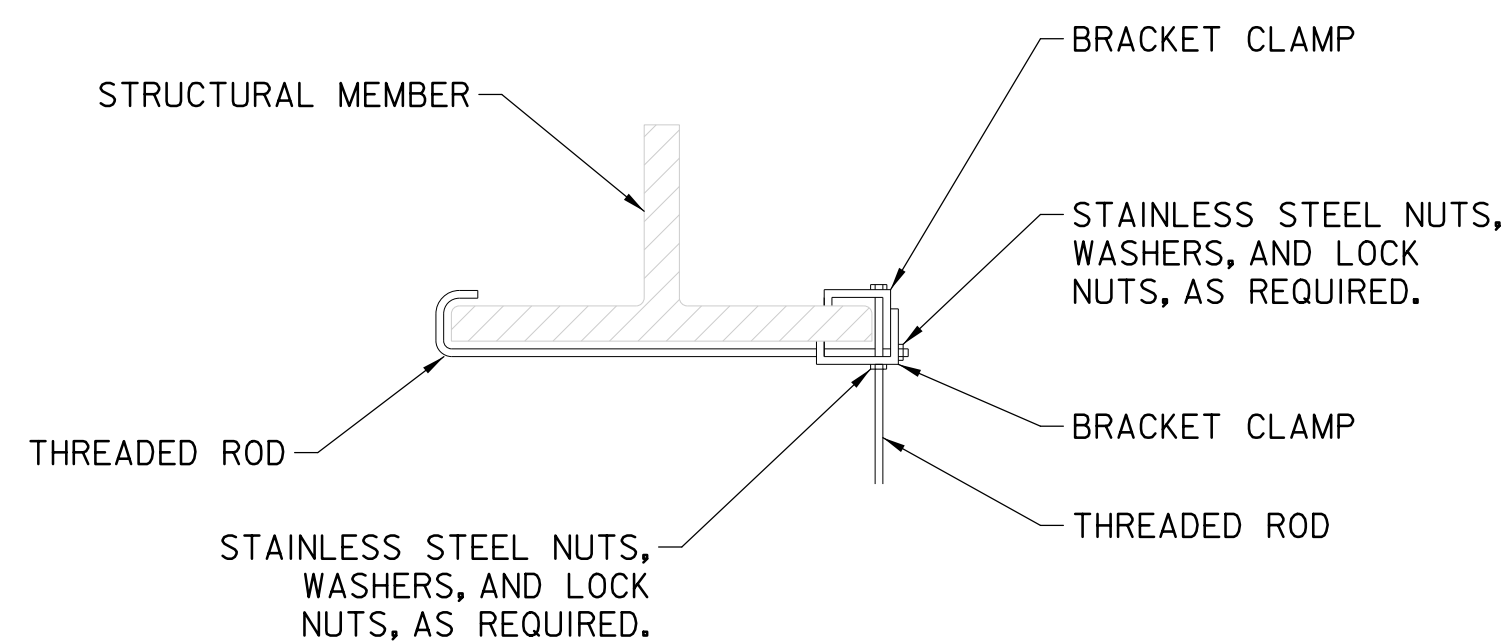

**THREADED ROD CLAMP**

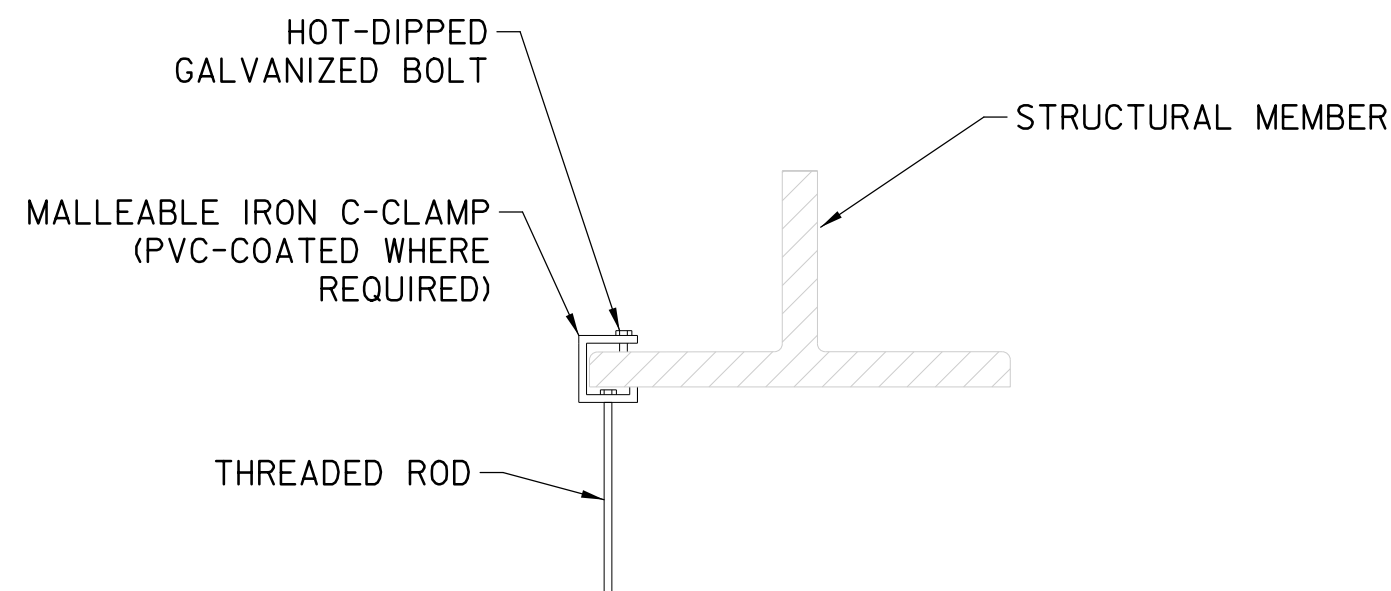


**C-CLAMP ATTACHMENT**

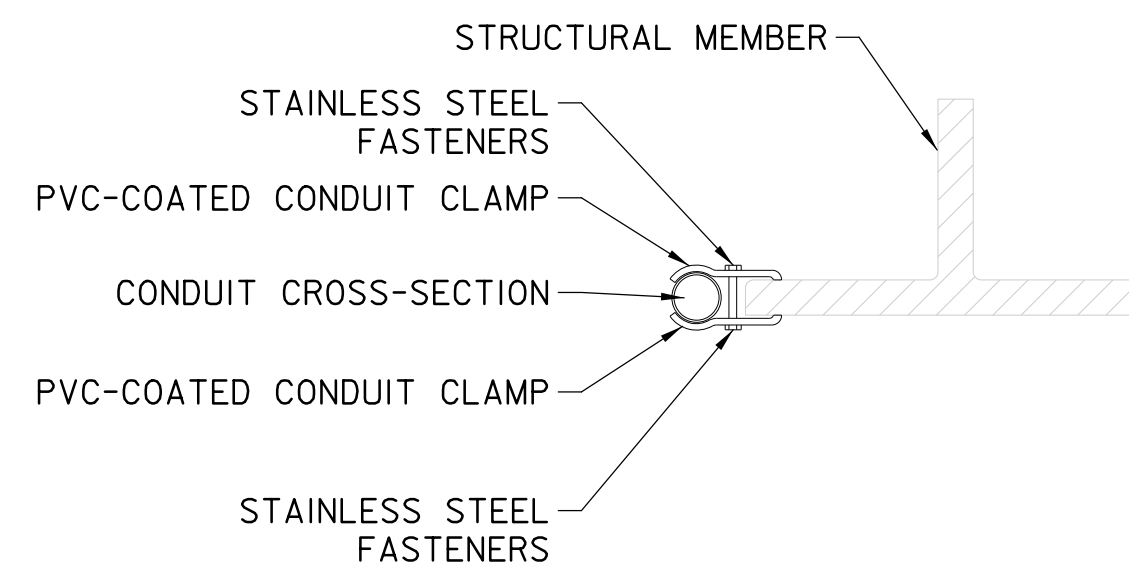

**SINGLE NO-DRILL CONDUIT CLAMP**


**STRUCTURAL MEMBER ATTACHMENT TYPES**

SCALE: 1"=1'-0"

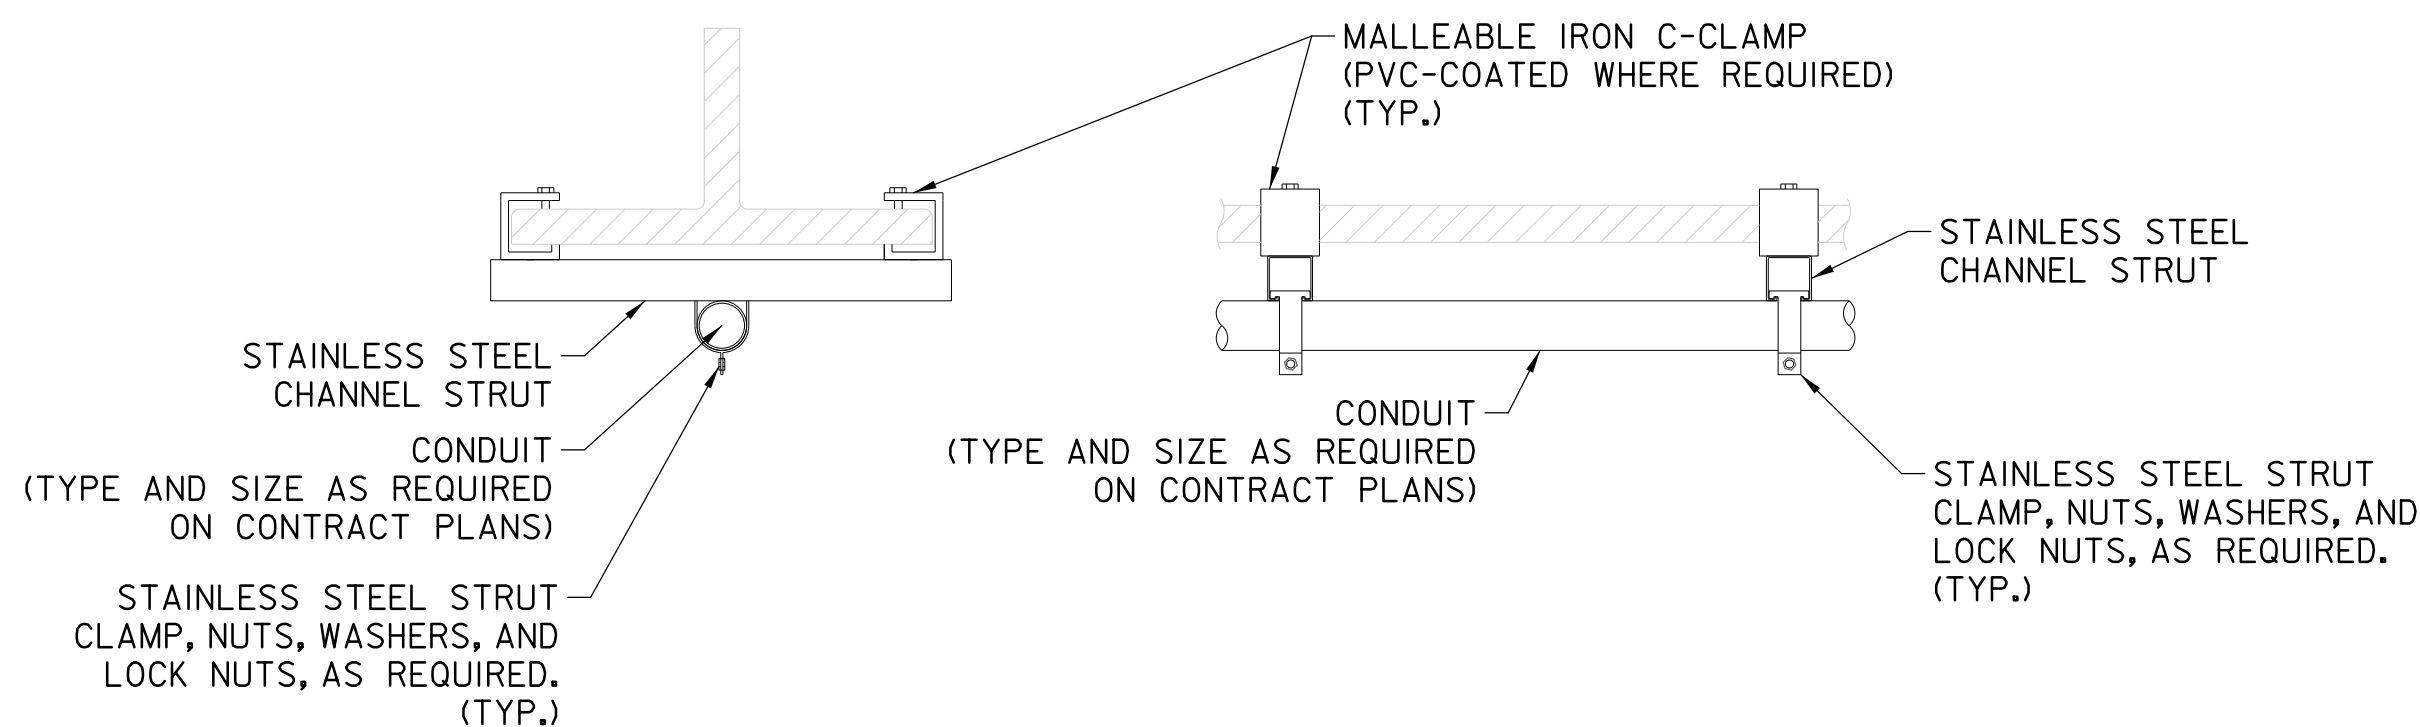


**PARALLEL CONDUIT MOUNT**

SCALE: 1"=1'-0"

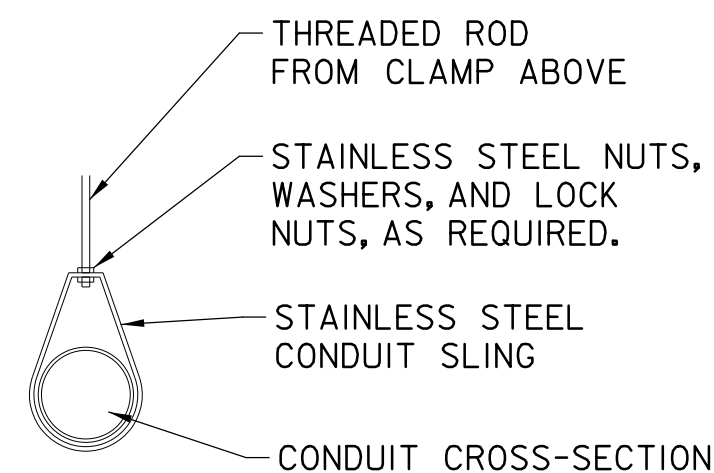


**SUSPENDED CONDUIT SLING**

NOT TO SCALE

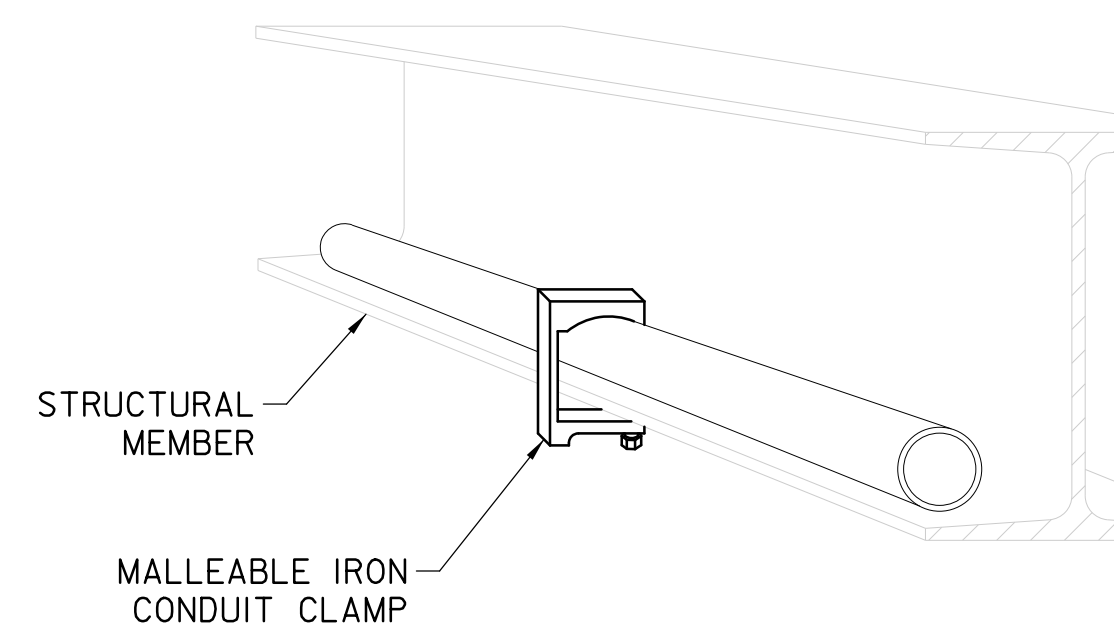


**STRUCTURAL MOUNTED LUMINAIRE INSTALLATION DETAIL, TYPE S**

NOT TO SCALE

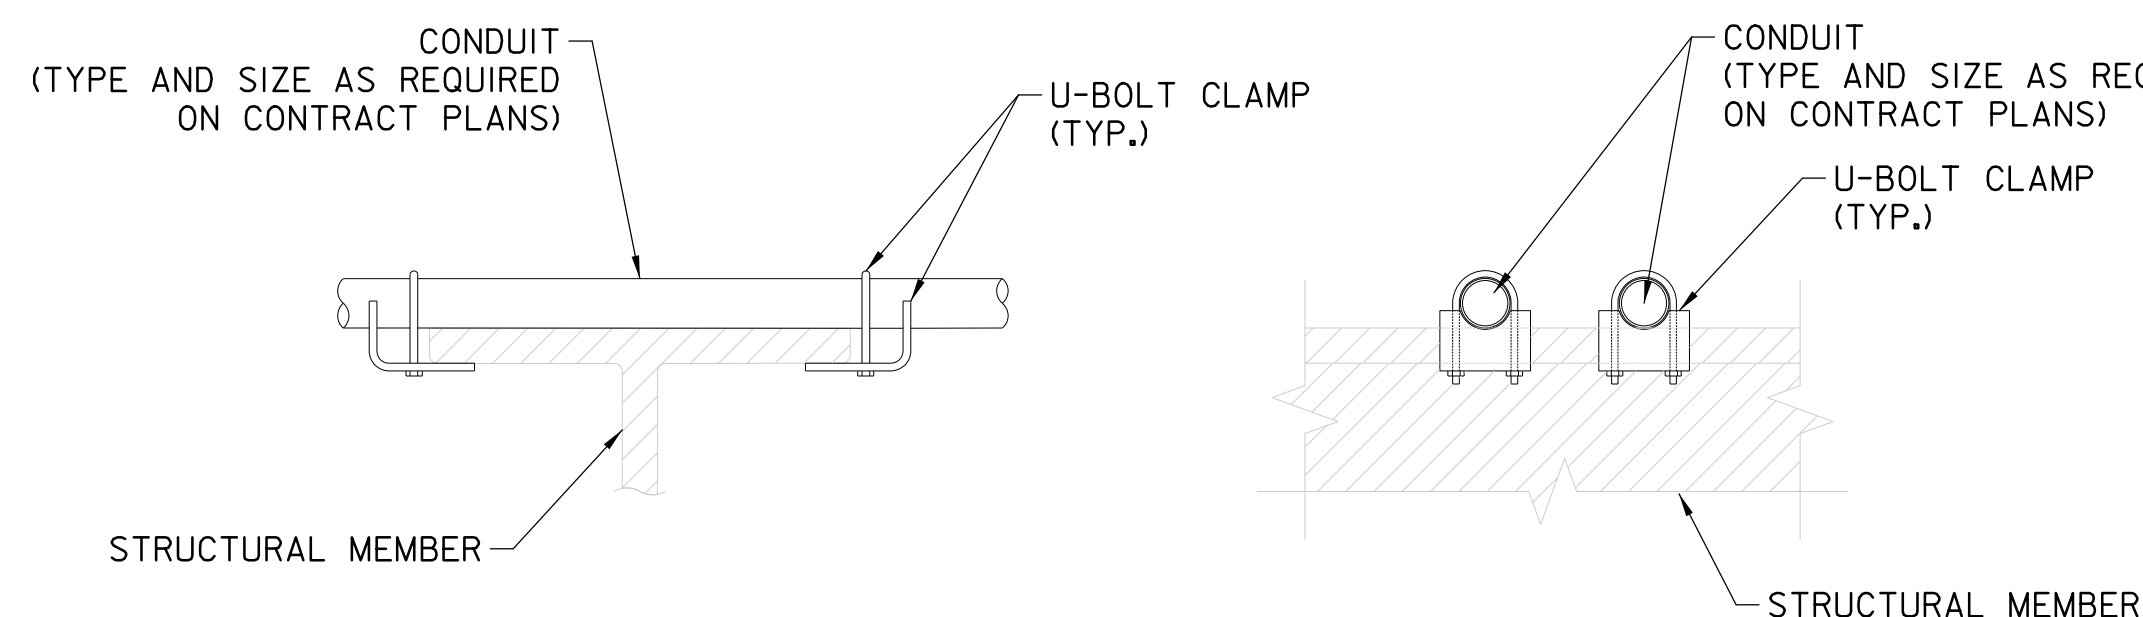

**PERPENDICULAR CONDUIT MOUNT**

SCALE: 1"=1'-0"

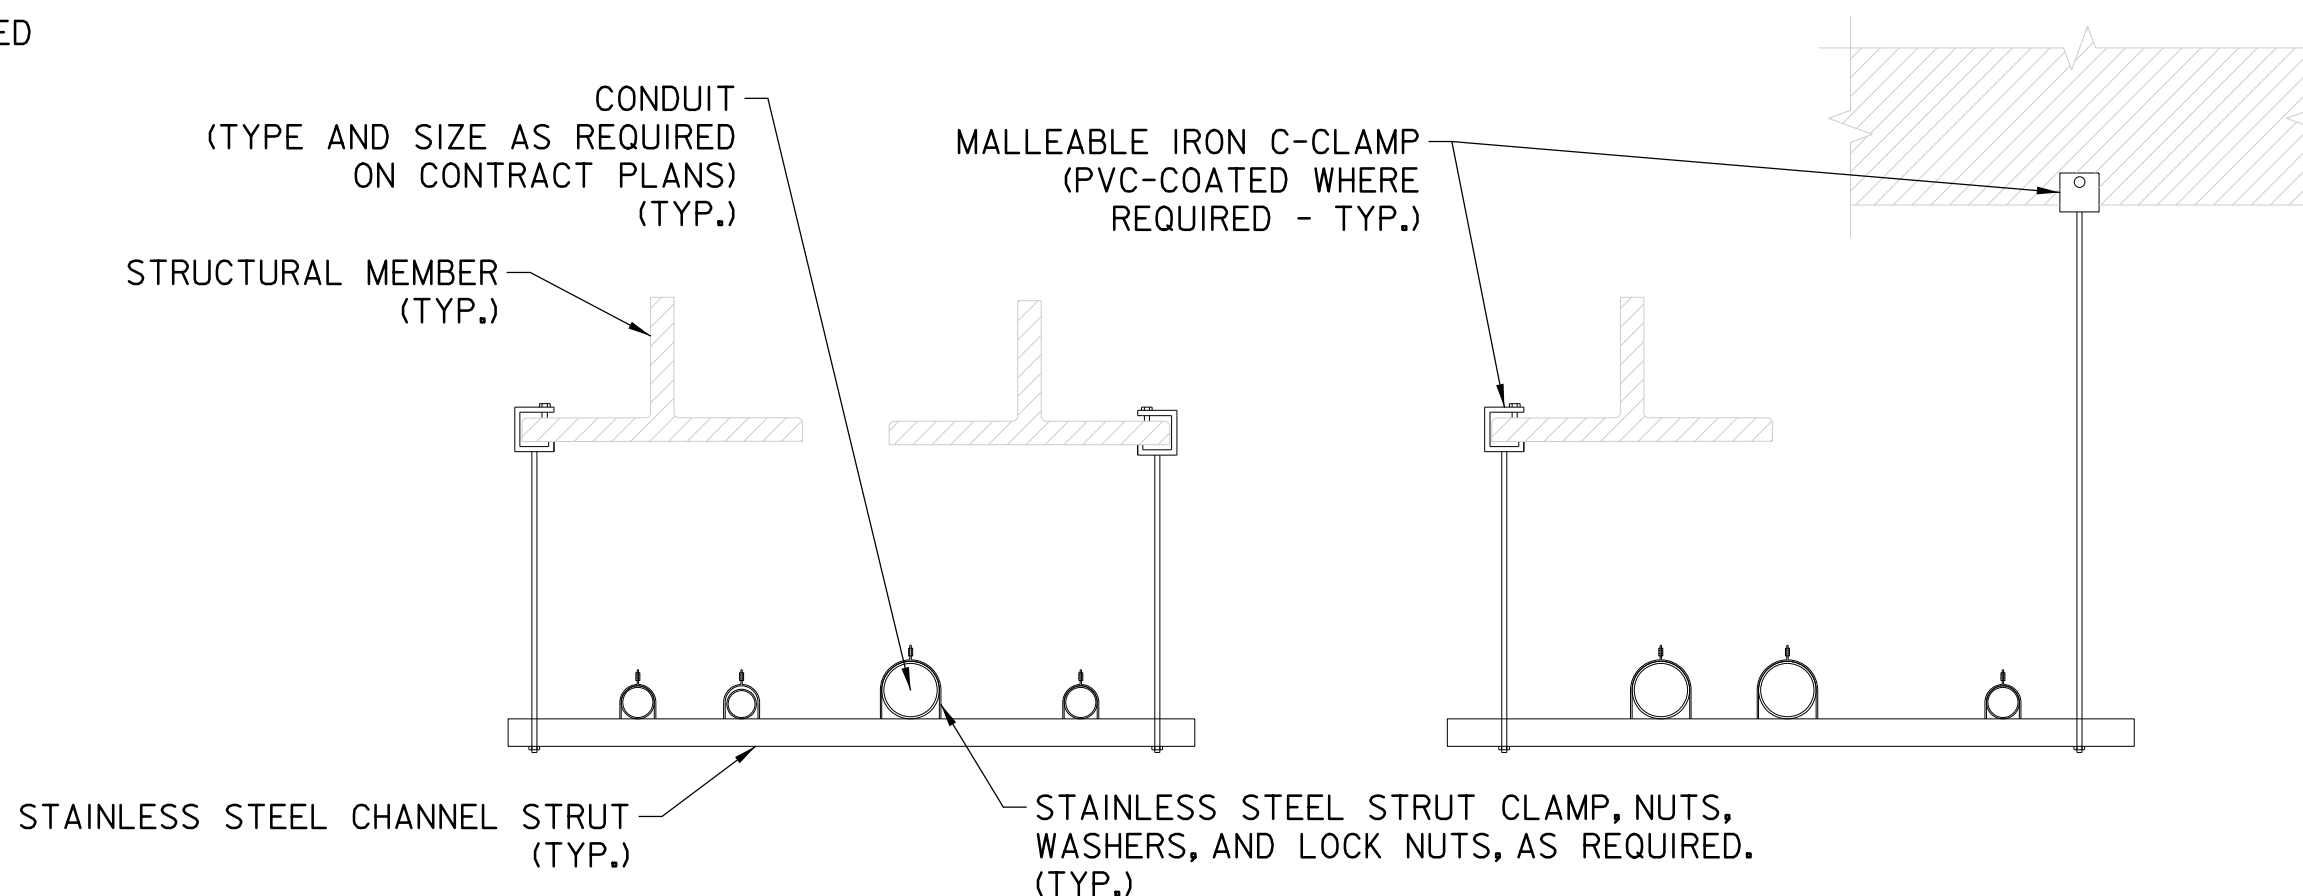


**PARALLEL CONDUIT**

**ALTERNATE INSTALLATION**

**CONDUIT TRAPEZE**

NOT TO SCALE

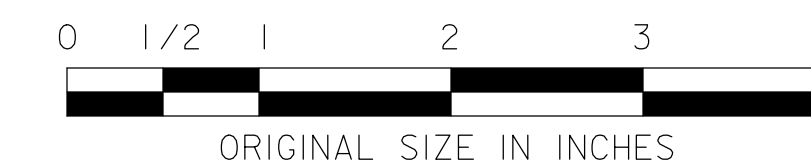

**NOTES**

1. METHODS SHOWN MAY BE USED IN COMBINATION TO ACHIEVE VARIOUS INSTALLATIONS WITHOUT DRILLING OR WELDING STRUCTURAL STEEL.
2. SEE CONTRACT PLANS FOR CONDUIT INSTALLATION TYPE.

NEW JERSEY TURNPIKE AUTHORITY  
**NEW JERSEY TURNPIKE  
 GARDEN STATE PARKWAY**  
 STANDARD DRAWINGS

**CONDUIT INSTALLATION DETAILS**

OFFICE OF THE CHIEF ENGINEER  
 NEW JERSEY TURNPIKE AUTHORITY  
 WOODBRIDGE, NEW JERSEY

STANDARD DRAWING

**E-26**

|      |                  |       |
|------|------------------|-------|
| 0    | REISSUED DRAWING | 09/21 |
| REV. | DESCRIPTION      | DATE  |